


RIVERSIDE PUBLIC UTILITIES DEPT. - UNDERGROUND STRUCTURES

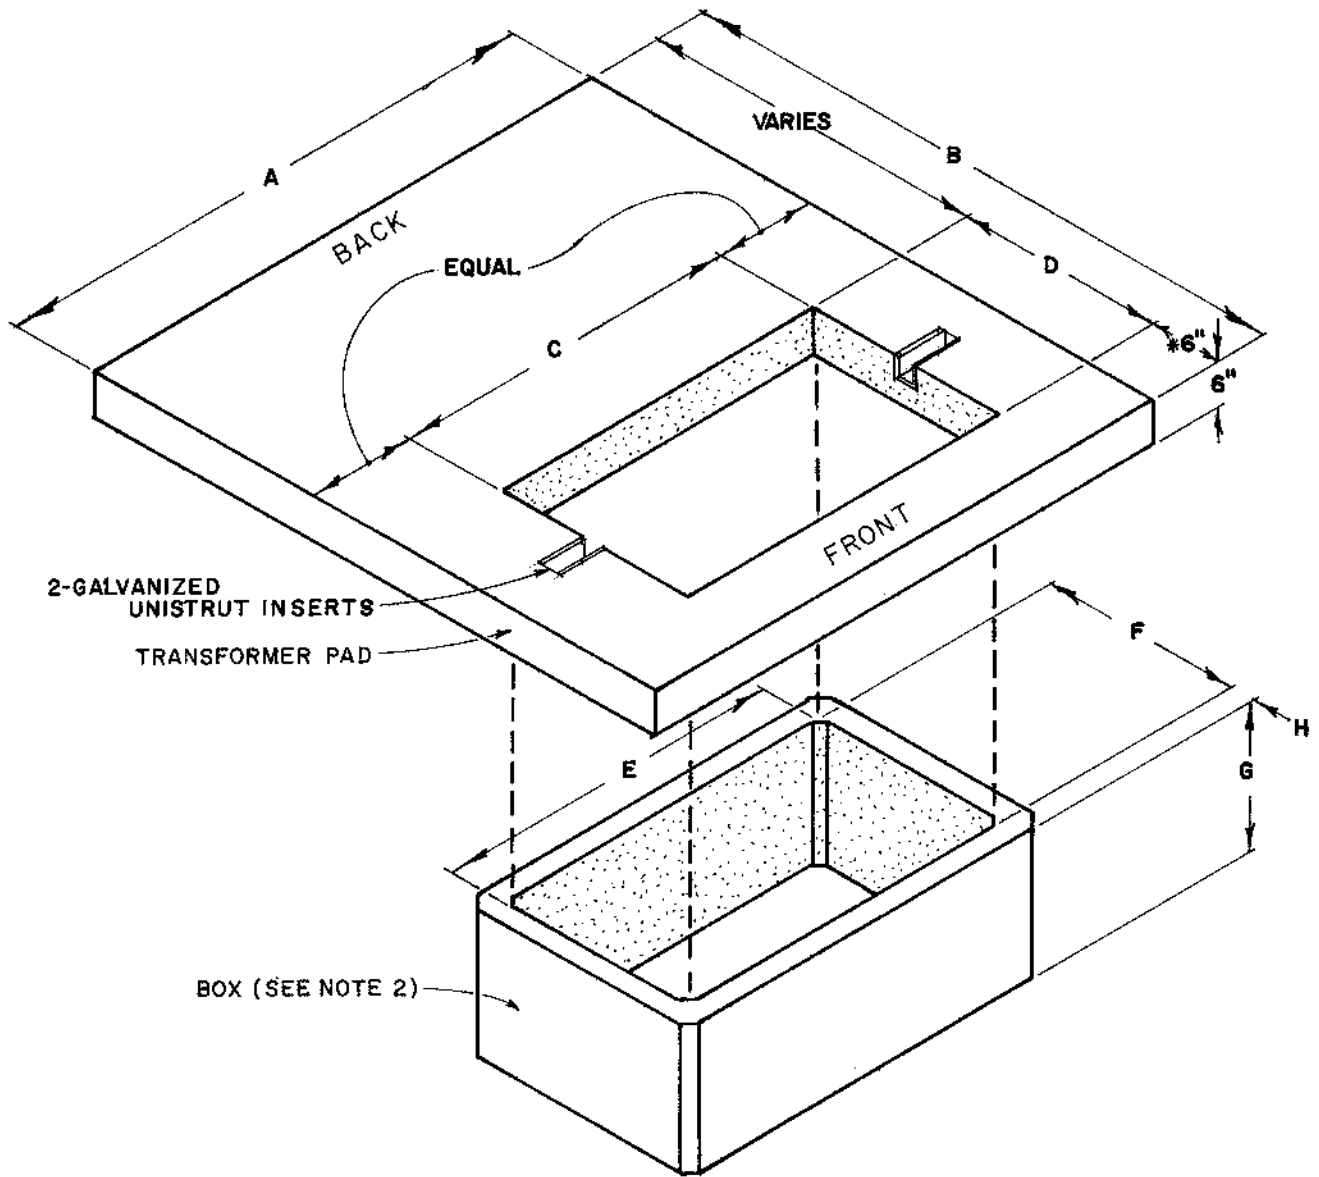

1. SEE UGS-621 FOR INSTALLATION DETAILS.
2. PAD IS TO BE INSTALLED WITH OR WITHOUT BOX AS SPECIFIED ON WORKING DRAWINGS.
3. PRECAST UNITS MAY BE OBTAINED FROM:
BROOKS PRODUCTS INC.
QUIKSET UTILITY VAULTS INC.
4. FOR QUIKSET PAD WITHOUT BOX DROP "B" FROM CATALOG NUMBER.

*This Dimension is 7" on TP-6 - TP-8

ITEM NO.		DIMENSIONS-INCHES								MANUFACTURER	CAT. NO.	
WITH BOX	WITHOUT BOX	PAD				BOX					PAD	BOX
		A	B	C	D	E	F	G	H			
TP-1	TP-2	36	42	18	11	22	12½	12	1¼	BROOKS	1520-1	5
		36	42	18	11	22	12	12	1	QUIKSET	SB-06-29	E-22
TP-3	TP-4	48	54	26	18	30	17	12	1¾	BROOKS	1510-12	66
		48	54	26	18	30	17	12	1¾	QUIKSET	SB-1.6	E-30
TP-5	TP-6	72	66	38	18	41	17	12	1½	BROOKS	1551-1	72
		72	66	38	18	44	16	12	1½	QUIKSET	S-2.6-56	E-44
TP-7	TP-8	94	72	50	18	48	30	14	1½	BROOKS	1635-1	68
		94	72	50	18	44	16	12	1½	QUIKSET	S-3.6-68	E-44

Revised

Don Campbell 6-80
Electrical System Manager

Indicates Latest Revision

UGS-620